



PRO (MEDIUM) DRY FERTILIZER FEED CHART

100x Stock Tank	g/gal
PART A	250
PART B	450
PK	200

STAGE	Clone	Early Veg	Late Veg	Early Flower	Mid Flower	Late Flower	Finish
WEEK	1,2	1	2,3,4	1,2	3,4,5,6	7,8	9
EC	1.1	2.0	2.2	2.4	2.7	2.4	1.3
PPM 500(TDS/500)	550	1000	1100	1200	1350	1200	650
PART A	20	40	45	40	45	40	20
PART B	20	40	45	40	45	40	20
PK	-	-	-	40	45	40	20
E-PLUS	2	3	3	2	2	2	2

100x mL / gal

STAGE	Clone	Early Veg	Late Veg	Early Flower	Mid Flower	Late Flower	Finish
WEEK	1,2	1	2,3,4	1,2	3,4,5,6	7,8	9
EC	1.1	2.0	2.2	2.4	2.7	2.4	1.3
PPM 500(TDS/500)	550	1000	1100	1200	1350	1200	650
PART A	0.53%	1.06%	1.19%	1.06%	1.19%	1.06%	0.53%
PART B	0.53%	1.06%	1.19%	1.06%	1.19%	1.06%	0.53%
PK	-	-	-	1.06%	1.19%	1.06%	0.53%
E-PLUS	0.05%	0.08%	0.08%	0.05%	0.05%	0.05%	0.05%

100x %


- Depending on source water, EC/PPM results may vary.
- This chart is a basic guideline.
- Measure the PPM of runoff weekly; runoff should be within +/- 20% of initial feeding.
- For longer vegetative cycles, continue week 4 feeding.
- For longer reproductive cycles, continue week 9 feeding.
- E-PLUS is an optional additive.

Have questions? We're here to help.


www.rxgreentechnologies.com | info@rxgreentechnologies.com | 603-769-3450

DOSATRON DIAGRAM FOR USE:

VEG STAGE:

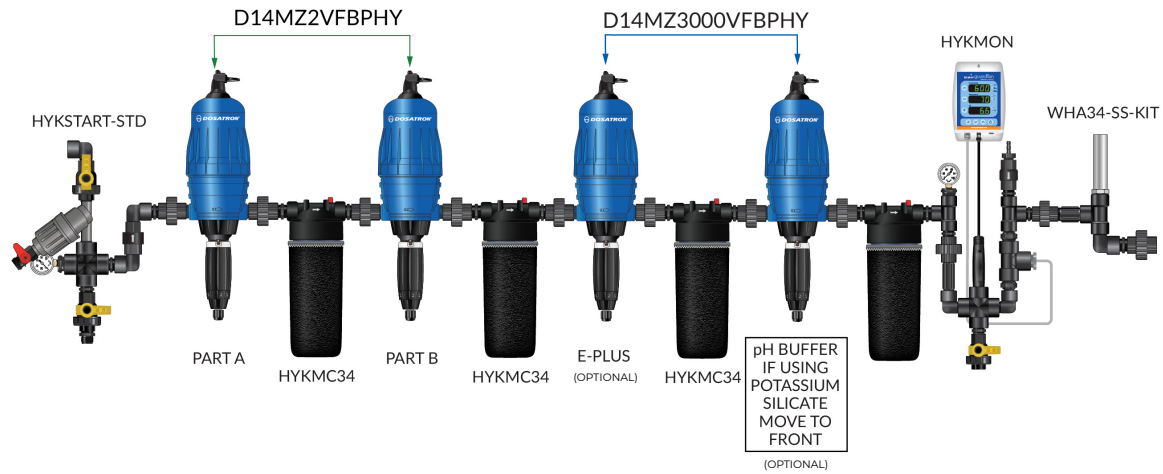

FLOWER STAGE:

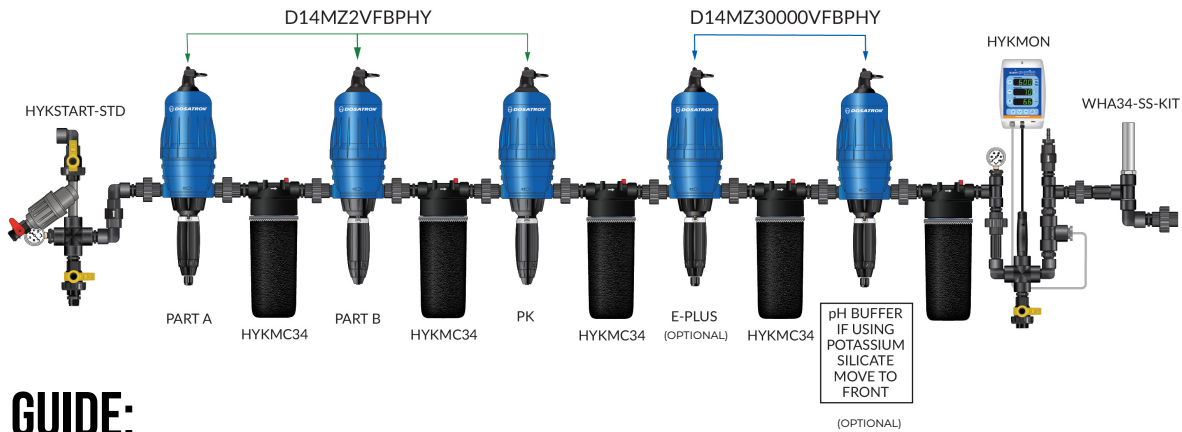

MIXING GUIDE:

DRY: READY TO USE SOLUTION (Batch Tank)

- Part A, Part B, and PK can be mixed in any order.
- Can be used in conjunction with other inputs when combined properly.
- Subtract EC/PPM of starting water to from mix when matching EC/PPM from Feed Chart.
- If using beneficials add after adjusting pH.
- For best results keep tank agitated.

DRY: INDIVIDUAL STOCK TANK SOLUTION 1:100 INJECTION RATIO

- All parts must be mixed in separate tanks at this ratio.
- Do not exceed 100x concentration in stock tanks.
- Solutions exceeding 100x may not remain in solution.
- Can be used in conjunction with other inputs when combined properly.
- Subtract EC/PPM of starting water to from mix when matching EC/PPM from Feed Chart.
- If using beneficials add after adjusting pH.
- For best results keep stock tanks agitated.

Have questions? We're here to help.